


REVISION HISTORY				
ZONE	REV	DESCRIPTION	DATE	APPROVED
FAN LEVEL	1	UL FAN MODULE	7/06/2010	P CH
MAIN FILTER LEVEL	2	METAL CLAMPS	8/12/2011	P CH
RIGHT SIDE	3	METAL SHOEBOX	3/28/2012	P CH
TOP COVER	4	UL FAN METAL MODULE	11/6/2017	P CH

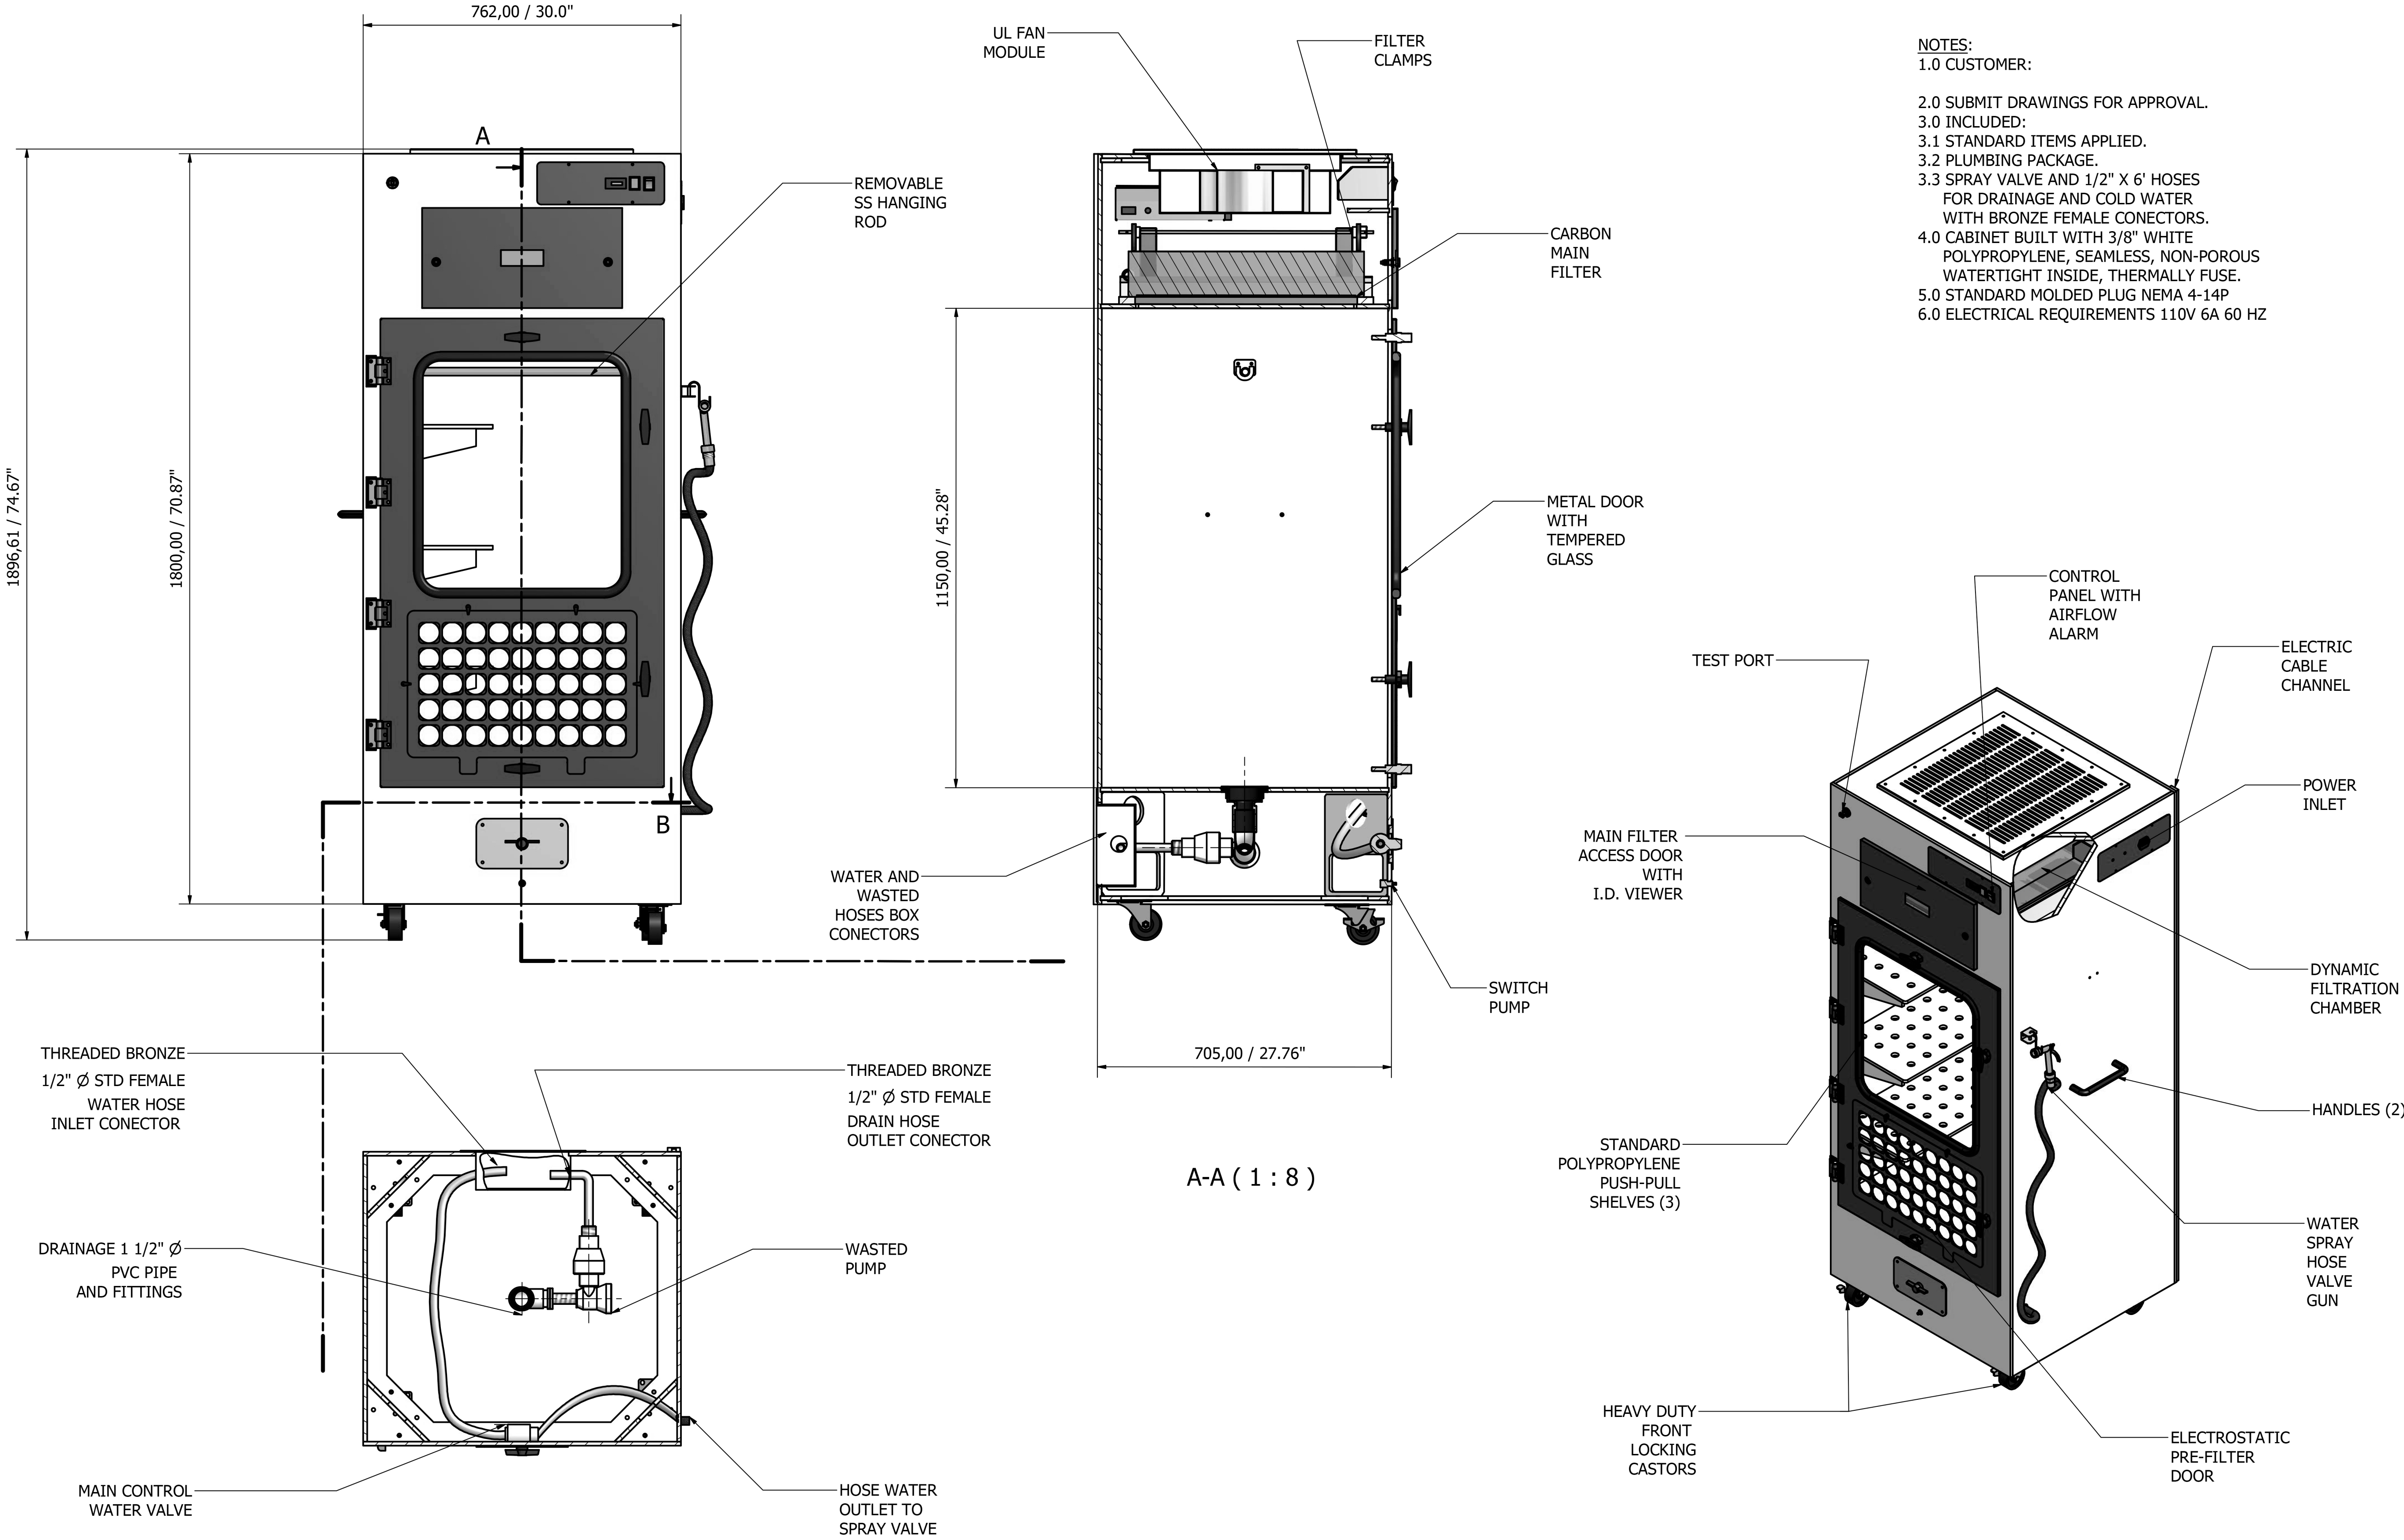

- NOTES:
- 1.0 CUSTOMER:
 - 2.0 SUBMIT DRAWINGS FOR APPROVAL.
 - 3.0 INCLUDED:
 - 3.1 STANDARD ITEMS APPLIED.
 - 3.2 PLUMBING PACKAGE.
 - 3.3 SPRAY VALVE AND 1/2" X 6' HOSES FOR DRAINAGE AND COLD WATER WITH BRONZE FEMALE CONECTORS.
 - 4.0 CABINET BUILT WITH 3/8" WHITE POLYPROPYLENE, SEAMLESS, NON-POROUS WATERTIGHT INSIDE, THERMALLY FUSE.
 - 5.0 STANDARD MOLDED PLUG NEMA 4-14P
 - 6.0 ELECTRICAL REQUIREMENTS 110V 6A 60 HZ

Designed by CFG	Checked by	Approved by	Date 4/22/2010	
			DC30UL.1800 SAFEKEEPER	
			DC30UL-Gassem	Edition 4 Sheet 1 / 1